


BREMERTON FIRE DEPARTMENT
911 Park Ave.
Bremerton, WA 98337
360.473.5380

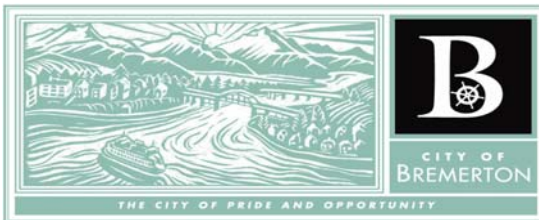

FIRE MARSHAL'S OFFICE
Fire Marshal 473.5384
Deputy Fire Marshal 473.5385
Deputy Fire Marshal 473.5284

Date:	Time:	Fire Zone:	Phone:	Last Service Date:
				Extinguishers
Business Name:		Occupancy Type:		Alarms
				Sprinklers
Owner/Manager Name:				Hood
				Halon/FM 200
Address:				Correction Date:
				Re-inspected:

Your attention is called to the following violations of the International Fire Code and/or other applicable Local, State and National Codes.

Fire Prevention Inspection Report

Right of Entry The Fire Code official shall have the authority to enter the building or premises at all reasonable times to inspect or to perform the duties imposed upon the fire code official by this code.(IFC 104.3)

<input type="checkbox"/> No Deficiencies Found <input type="checkbox"/> Please correct the following violation(s) on or before the date listed. Failure to correct these violation(s) will result in further legal action. <input type="checkbox"/> Please submit a letter of compliance when these items are corrected or fax to 473.5397	<input type="checkbox"/> Have your fire alarm system, fire sprinkler systems and portable extinguishers serviced by a certified technician. This must be accomplished on at least an annual basis. <input type="checkbox"/> Have your range hood suppression system serviced every six months by a certified technician. <input type="checkbox"/> A re-inspection will be made at the end of a specified time.
<input type="checkbox"/> 304.3.3 Dumpsters shall not be within 5 feet of combustible wall or eve. <input type="checkbox"/> 315.2 Storage of combustible materials in buildings shall be orderly. <input type="checkbox"/> 315.2.1 Ceiling clearance. Storage shall be maintained 2 feet or more below the ceiling in non sprinklered areas of buildings or a minimum of 18 inches below sprinkler head deflectors in sprinklered areas of buildings. <input type="checkbox"/> 315.2.2/3 Combustible materials shall not be stored in exits or exit enclosures. Combustible material shall not be stored in boiler rooms, mechanical rooms or electrical equipment rooms. <input type="checkbox"/> 404.4 Provide approved evacuation plan . <input type="checkbox"/> 505.1.1 Address numbers for commercial buildings shall be 0-50" from street or less: 6-12" minimum height; 50' to 100' from Street: 12-18" minimum height; More than 100' from Street: 18-24" minimum height. <input type="checkbox"/> 506.1 Provide a Knox Box to be installed in an approved location. Provide keys necessary for access. <input type="checkbox"/> 605.3 A working space of not less than 30 inches in width, 36 inches in depth and 78 inches in height shall be provided in front of electrical service equipment . <input type="checkbox"/> 605.1 Identified electrical hazards shall be abated. Identify all breakers. Provide cover plates for all electrical boxes and remove all multi-plug adapters <input type="checkbox"/> 605.3.1 Doors into electrical control panel rooms or Fire Protection Systems shall be marked with a plainly visible and legible sign . <input type="checkbox"/> 605.5 Extension cords and flexible cords shall not be a substitute for permanent wiring. Extension cords shall be used only with portable appliances. <input type="checkbox"/> 605.6 Open junction boxes and open wiring splices shall be prohibited. Approved covers shall be provided <input type="checkbox"/> 703.1 Maintain Fire Rated construction	<input type="checkbox"/> 703.2.2 Remove door hold open devices/doors equipped with automatic door closers shall be maintained in the closed position. <input type="checkbox"/> 901.6.1/2 Provide service and test records for fire protection systems <input type="checkbox"/> 903.3.7 Fire Department connections shall be provided with threaded or Knox lockable caps/FDC's shall be immediately accessible <input type="checkbox"/> 1003.6 Obstructions shall not be placed in the required width of a mean of egress. Exits shall not be obstructed in any manner. <input type="checkbox"/> 1006.1 The means of egress, including the exit discharge, shall be illuminated at all times. <input type="checkbox"/> 1008.1.8 and 1008.1.8.3 Exit doors shall be openable from the inside without a key or special knowledge or effort. Double keyed deadbolts are not allowed Post a sign " <i>This door to remain unlocked during business hours</i> ". <input type="checkbox"/> 1026.3/4 Exit signs shall be internally or externally illuminated. Exits and exit doors shall be marked by an approved exit sign readily visible from any direction of egress travel. <input type="checkbox"/> 3003.2 Stationary and portable compressed gas containers , cylinders, tanks and systems shall be marked and secured against unauthorized entry and safeguarded in an approved manner. 3003.2.1, 3003.2.2, 3003.2.3 and 3003.3.1. <input type="checkbox"/> Sec. 2205.3.1. Provide at least 50 pounds of rice hulls or other approved absorbent and at least 25 approved absorbent pads, minimum dimension 16 inch by 16 inch and/or other spill control equipment <input type="checkbox"/> 3404.3.4.2 Provide a flammable liquids storage cabinet . <input type="checkbox"/> 3403.5.3 Warning labels. Individual containers, packages and cartons shall be identified, marked, labeled and placarded in accordance with federal regulations and applicable state laws. Provide MSDS sheets. <input type="checkbox"/> 3404.2.13.1.2/3 Underground Storage Tanks need to be capped within 90 days and removed within 1 year.

Owner/Manager:	Inspector: